



Prüfinstitut für
Abwassertechnik
GmbH

Testing Certificate


Hydraloop International b.v.
Agora 4, 8934 CJ Leeuwarden, Netherland

Hydraloop
Greywater Treatment System with UV Disinfection
Test report – 201806_GW_PIA_Hydraloop International_V02

5 weeks inhouse test of the Hydraloop system with nominal loading		
Hydraulic Daily Flow Dosage	200 L/d 40 L/dosage	
Test was carried out with synthetic greywater (bathing + laundry source waters)		
Average Effluent Values	Turbidity	3 NTU
	CBOD	9 mg/L
	TSS	2 mg/L
	E.Coli	< 1 cfu/100mL
Energy consumption	0,55 kWh/d	

Performance tested by:

PIA – Prüfinstitut für Abwassertechnik GmbH
(PIA GmbH)
Hergenrather Weg 30
52074 Aachen

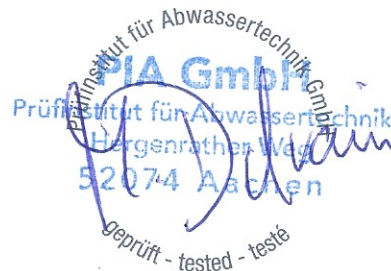

November 2018